

Installation and
operating instructions Ice detector
EM 524 89
EM 524 90

for open spaces and gutter heating



Contents

Instructions/General Descriptions	3
Menu mode	4
Menu items	8
Alarm messages	10
Design	11
Operating	11
Sensor for open spaces	12
Combined temperature and moisture sensor	13
Sensor assembly	14
Installation examples	18
Ice and snow sensor	20
Temperature sensor	21
Setting desired values	23
Operating modes	24
Maintenance	26
Storage program	26
Connection diagrams	27
Appendix:	
Technical data	33
Dimensions	35
Brief operating instructions	36

WARNING:

This independent electronic device can be installed for the fully automatic electric heating of open spaces, garage drives, stairs, ramps, flat roofs and gutters.

The device must only be installed by a qualified electrician in accordance with the connection diagram. Pay strict attention to the latest electrical safety standards and the local electricity supply company's safety instructions. The device is intended for installation in control cabinets or distributors. To achieve protection class II the appropriate installation measures must be taken. The device complies with EN 60730 and works in accordance with operating mode 1C.

Proper operation is only possible if the system is installed before there is frost or snow and not when the open spaces or gutters to be heated are already covered with snow or ice. It is recommended that the system is left on during the entire heating period!

Note!

The system will only work properly if the thermal output of the space to be heated has been calculated properly or adapted to local conditions. Please contact your system installer.

Instructions

The ice detector is installed for the fully automatic electric heating of open spaces, garage drives, stairs, ramps, flat roofs and gutters. Unlike manually controlled (touch-dependent) or thermostatically controlled (only temperature dependent) systems, the heating will only be switched on if there is a danger of slippery conditions, i.e. snow, ice or sleet and will, naturally, be switched off after thawing. This ensures energy savings of up to 80% compared with thermostatically controlled systems.

General description

2-zone EM 524 90 and 1-zone EM 524 89

The 2-zone device is a dual device. It combines the function of two EM 524 89 regulators in one housing. Apart from this dual nature, the single zone EM 524 89 has the same features and capability.

There is a combined LCD display, input buttons and combined electronics.

There are two of all the other features. A dual set of sensors for temperature and moisture. Two separate relays for the heating circuits.

There is one sensor for air temperature, for detection of a sudden drop in temperature, and this is used jointly. There is only one alarm relay.

The two separately functioning parts of the device are called zones, Zone A and Zone B.

The zone A sensors are connected to the group of terminals 19 to 27.

The zone B sensors are connected to the group of terminals 28 to 36.

The zone A heating circuit is connected to terminals 14 and 15.

The zone B heating circuit is connected to terminals 17 and 18.

EM 52489: the sensors are connected to the group of terminals 10 to 19.
the heating circuit is connected to terminals 8 and 9.

The functionalities of both zones work completely independently of each other.

All of the above-mentioned sensors can be used for each of the zones independently of each other in any combination you wish.

Both zones can be set independently in various ways using the menu. Constant display of the operating status also takes place separately according to the zones, whereas the LED indicator lights on the front panel show the zone which is currently being displayed.

When operating the device, in order to be able to distinguish between both parts of the device, there is a menu item called "Zone", which can be used to switch between the menus for both zones. The two LED diodes on the front panel indicate which of the menus you are currently viewing.

Language settings and settings for display of °C / °F always apply for both parts of the device, whereas all other settings relate only to the relevant zone.

Menu mode

1-zone controller

The ice detector settings can be monitored and adjusted using 3 buttons and a two-line 16-digit display.

Button **MENU:** This button is used to call up the individual menu items.

Button **VALUE:** This button is used to call up the possible settings.

Button **ENTER:** This button is used to store the desired values in the memory.

The ice detector has two operating modes which are shown on the display.

1. Measured values mode
2. Menu mode

If the ice detector is connected in compliance with the circuit diagram, the voltage is switched on and no button is pressed within 20 seconds, the display will be in "measured values" mode. If a button is pushed the display will change to "Menu" mode.

2-zone controller

The ice detector settings can be monitored and adjusted using 4 buttons and a two-line 16-digit display.

Button **MENU:** This button is used to call up the individual menu items.

Button **- and +:** These buttons are used to call up the possible settings.

Button **ENTER:** This button is used to store the desired values in the memory.

The ice detector has two operating modes which are shown on the display.

1. Measured values mode
2. Menu mode

If the ice detector is connected in compliance with the circuit diagram, the voltage is switched on and no button is pressed within 20 seconds, the display will be in "measured values" mode. If a button is pushed the display will change to "Menu" mode.

“Measured value” mode = normal operation

The current measured values are displayed in this mode:

On the 2-Zone controller EM 52490 the display shows Zone A and Zone B values alternately in six-second intervals. The appropriate LEDs are illuminated.

GROUND/ROOF:	From -45 to +78°C (-49 to 172°F)	
AIR:	From -45 to +78°C (-49 to 172°F)	Note 1*
MOISTURE:	From 0 to 9	
HEATING:	OFF and ON	

The display changes in three-second intervals between GROUND/ROOF and AIR values on the one side and MOISTURE and HEATING on the other.

(within the zone chosen on the 2-zone controller EM 52490)

Controls

For example:

GROUND/ROOF:	-11°C
AIR:	-10°C (Note 1*)

or:

MOISTURE:	7
HEATING:	ON

If an alarm is on this is also displayed alternately for 3 seconds.

Note 1*:

The air temperature will only be displayed if the air temperature sensor (available as an optional extra) is also connected (TFD 524 004 on terminals 37 and 38). If no air temperature sensor is connected, then the supplied resistor 82 kΩ (on terminals 37 and 38) must be connected as otherwise the system detects that a sensor has failed.

Menu mode

The ice detector has two operating modes which are shown on the display.

In this mode the menu text is displayed in the top line of the menu text and the set value in the bottom line.

If you press the buttons – or + on the 2-zone Controller or the VALUE button on the 1-zone Controller, the value of this menu item, shown in the bottom line, is changed onwards or backwards.

If you press the bottom button (ENTER), the selected value is stored in the memory. This selection is marked by the word ACTIVE, right-justified in the bottom line.

Menu	Delivery setting	Range
TEMP. UNIT	°C	°C, °F
LANGUAGE	DEUTSCH	DEUTSCH, ENGLISH, FRANCAISE, SUOMI, SVENSKA, CESKY, DUTCH, MAGYAR, TURKCE, POLSKI, ITALIANO

These are the factory settings and will appear when first powering up the Controller. The user should set these to the desired value at this point. Resetting the Controller to the 'STANDARD PROGRAM' will not effect these settings.

For example: TEMPERATURE
 + 4°C ACTIVE

If no button is pressed within 20 seconds the display changes to “Measured value” mode.

Menu	Default value	Range	Remarks
ZONE (only available on 2-zone Controller)	A	A, B	
APPLICATION	GROUND	GROUND, ROOF, OFF	2
RANGE	-10°C (14°F)	-5°C ... -20°C (23°F...-4°F), OFF	
TEMPERATURE	+3°C (37°F)	0°C ... 6°C (32°F ... 43°F)	
MOISTURE	3	1 ... 8 OFF	
BASE TEMPERATURE	OFF	-15°C ... -1°C, OFF (5°F ... 30°F)	1
AFTER RUN TIME	20 M	10 M ... 24 H, OFF	
OPERATION	AUTOMATIC	AUTOMATIC, PERMANENT	
STANDARD PROGRAM	ON	ON, OFF	
SENSOR HEATER	ON	AUTOMATIC, ON	
LANGUAGE	User defined	DEUTSCH, ENGLISH, FRANCAISE SUOMI, SVENSKA, CESKY, MAGYAR, TURKCE, POLSKI, ITALIANO	
TEMP. UNIT	User defined	°C, °F	2
COUNTER	xxxxxHyyM		

Remarks:

- 1: This menu item only appears in the GROUND application
- 2: During the initial installation the default value for the Language menu item is German, for the display menu item, °C, for the application menu item, ground, after which these menu items no longer form part of the default settings.

Menu items

Zone: _____ Range: A, B Default value: A
(only available on 2-zone Controller)

This setting is used to select the zone which the further menu items will relate to. The Displayed value and Language menu items always apply for both zones. All other menu items always relate to only one zone. You must set which zone is meant before further settings are made, with the aid of the Zone menu item. This is then displayed by the relevant LED.

Application: _____ Range: GROUND, ROOF, OFF Default value: GROUND
The application (gutter or ground) is selected with this setting. The application selected will be retained when you revert to the default program.

Range: _____ Range: -5 ... -20°C (23 ... -4°F), OFF Default value: -10°C
lower temperature limit.

This temperature value specifies the lower operating temperature limit. If OFF is preset on the 2-zone controller EM 52490, ONLY the appropriate zone is deactivated. Up to this temperature limit the ice detector operates in the normal mode (Heating ON, when the switch on conditions are satisfied). Below this temperature the ice detector will be in "Stand by" mode. If set to OFF, the ice detector works in normal mode at all temperatures.

Attention: The temperature set here has priority over the set ground temperature.

N.B. Heating cables must have sufficient capacity to heat the area, calculate the requirements before installing.

Temperature: _____ Range: 0 ... 6°C (32 ... 43°F) Default value: +3°C (37°F)
If the temperature falls below this set value, the ice detector will switch the heater on if the "moisture" menu item is switched off. If the moisture menu item is set at a certain value the heating system will only be switched on when the temperature falls below this value and the moisture level is exceeded.

Moisture: _____ Range: 1 to 8, OFF Default value: 3
The sensitivity to moisture is switched on and off here. If it is switched on, you can set a value between 1 (almost dry) and 8 (very damp). If it switched to OFF, the controller assumes it is damp and functions as a temperature controller.

Note: If the heating switches off too early, even though conditions are still damp, you can prevent this by adjusting the moisture level to 2. Differences in air pollution can influence the setting needed.

Base temperature: Range: -15 ... -1°C (5 ... 32°F) Default value: OFF
With this setting you can specify a temperature which the temperature of the area to be heated must not fall below. When a temperature is set here, the ice detector will switch the heating on immediately irrespective of the moisture levels, when the temperature falls below this preset value. This menu item is hidden in the roof application.

Attention: The limit temperature set under the RANGE menu item area has priority over the set ground temperature.

After run time: _____ Range: 10 M to 24 H, OFF Default value: 20 M

You can set an after run time of the heating of between 10 minutes and 24 hours here. This function can also be switched off.

Note: If there is still snow or ice remaining when the after run heating time has ended, you can increase the after run time. Bear in mind the increased heating costs should you do this. Ideally the setting should be assessed after 1-3 months of a winter season and the setting adjusted if necessary.

Operation: _____ Range: AUTOMATIC, PERMANENT Default value: AUTOMATIC

With this function, you can switch the heating on continuously, irrespective of the set temperatures and moisture levels. The heating remains switched on during an alarm.

Sensor heater: _____ Range: AUTOMATIC, ON Default value: ON

In Automatic mode the sensor heater is switched off when the heating system is switched On, this is specifically for roof applications where the heating cables cross, but should not be touching, or are next to the gutter sensor. In ON mode the sensor heater stays on when the heating system is switched on.

Standard program: _____ Range: ON, OFF Default value: ON

The ice detector settings can be reset to defined values here. This does not apply to the language, application, display and counter menu items. The set language, application and display are retained and the counter reading can be reset to zero via the appropriate menu item. You can only select ON with this menu item, as the default program is disabled by changing to another menu item.

Temp unit: _____ Range: °C, °F Default value: °C

Selection of the unit in which temperature values are to be displayed. °C Temperature values displayed in °C. °F: Temperature values displayed in °F. The selected display is retained when you revert to the default program.

Language: _____ Range: DEUTSCH, ENGLISH, FRANCAISE, SUOMI, SVENSKA, CESKY, DUTCH, MAGYAR, TURKCE, POLSKI, ITALIANO

Various languages can be selected for the ice detector display. German, English, French, Finnish, Swedish, Czech, Hungarian, Polish, Italian, Turkish and Dutch can be selected. The selected language is retained when you revert to the standard program.

Counter: _____ 00000H00M to 65535H59M

This is the operating hours' counter for the heating. It is displayed in hours and minutes. The counter reading is retained when you revert back to the default program. To reset the counter, select RESET with Buttons – and + (EM 524 90) or the VALUE button (EM 524 89) and then press "ENTER" to reset.

The various temperatures are displayed as double-digit values in °C and °F with the correct sign before them.

For example: _____ BASE TEMPERATURE
-10°C
or: TEMPERATURE
+3°C

The counter reading is displayed in hours and minutes.

For example: _____ COUNTER
00038H25M

This display corresponds to a heating operating time of 38 hours 25 minutes.

Alarm messages

In the event of an alarm, the display starts flashing at one second intervals. The alarm relay closing contact (1-zone = terminals 5 and 6, 2-zone = terminals 11 and 12) closes. The word "ALARM" appears on the top line, plus for the 2-zone Controller either Zone A or Zone B (where the alarm occurred), appears on the top on the right. At the same time, the cause of the alarm is displayed on the bottom line. This alarm display appears in addition to the other displays (measured values) for 3 seconds at a time. The heating relay closing contact (1-zone terminals 8 and 9, 2-zone terminals 14 and 15, or 17 and 18) opens unless continuous heating was selected.

Alarm	Fault	Wire colour	Connection EM 524 89	Connection EM 524 90
SHORT HEATER	Sensor heating moisture sensor Type ESF 524 001/011 or ESD 524 003 Sensor heater short circuit	brown/green	14/12	23/21, or 32/30
BROKEN HEATER	Sensor heating moisture sensor Type ESF 524 001/011 or ESD 524 003 Sensor heater open circuit	brown/green	14/12	23/21, or 32/30
SHORT TEMP	Temperature sensor Type TFF 524 002/012 or TFD 524 004: Temperature sensor cut out	brown/yellow or brown/blue	19/18	27/26, or 36/35
BROKEN TEMP	Temperature sensor Type TFF 524 002/012 Temperature sensor cut off or TFD 524 004:	brown/yellow or brown/blue	19/18	27/26, or 36/35
SHORT AIR TEMP	Air temperature sensor type TFD 524 004 Temperature sensor short circuit	blue/brown	21/20	38/37
BROKEN AIR TEMP	Air temperature sensor type TFD 524 004 Temperature sensor break	blue/brown or R 82 K Ω resistor missing	21/20	38/37
SHORT MOISTURE	Temperature sensor in moisture sensor Type ESF 524 001/011 or ESD 524 003 Temperature sensor short circuit	brown/yellow	14/13	23/22, or 32/31
BROKEN MOISTURE	Temperature sensor in moisture sensor Type ESF 524 001/011 or ESD 524 003 Temperature sensor break	brown/yellow	14/13	23/22, or 32/31

Table 2: Alarm messages

The settings of the menu items can be changed during an alarm; The display carries on flashing at one-second intervals to display the alarm.

The alarm statuses are still displayed up to approximately 5 secs. after fault clearance. When sensor heating is switched on (sensor temperature <4°C), it is permanently monitored for short circuits. It is switched off for 1 second every 4 minutes to test it for a break. If sensor heating is switched off (sensor temperature > 4°C), it is permanently monitored for a failure. It is switched off for 1 second every 4 minutes to test it for short circuits.

In the case of the Air temperature alarm, the device continues to function, but without detection of any sudden drop in temperature.

In the case of an error in one zone on the 2-zone Controller, the other zone continues to be regulated.

Operating

If the temperature set in the ice detector falls below the predetermined value and if the set moisture level is exceeded at the same time, the heating will be switched on by means of the HEATER relay and the terminals (see connection diagram). If one of these conditions is not fulfilled the heating will remain off.

The open space or the gutter heating remains switched on until the moisture levels fall below a predetermined value or the set temperature is exceeded.

If the after run heating function is needed (generally only if there is still snow remaining on the sides after the heating has been switched off) you can recall this function by pressing the MENU-button and the desired time set. The after run heating process takes over before the Controller switches the heating off again, as the temperature or the moisture levels no longer meet the conditions to be switched on.

The lower temperature limit is set (-5°C ... -20°C , OFF) in the RANGE menu item.

The upper temperature limit is fixed at $+6^{\circ}\text{C}$. Outside this limit the heating can only be switched on using the OPERATION menu item and setting it to PERMANENT.

The surface of the ice and snow sensors ESF 524 001/011 and ESD 524 003 are heated intermittently to thaw snow and ice. Water is then formed that the sensor will identify as moisture.

The BASE TEMPERATURE menu item has a setting range of -15°C ... -1°C and OFF. As an example, if this base temperature is set at -5°C and the temperature drops below -5°C , the controller will switch on the heating until this temperature is exceeded. If the temperature falls below this preset value, the heating will be switched on until this temperature is exceeded. The lower temperature (range) limit has priority over the base temperature. This means that if the base temperature is set lower than the range limit temperature, the base temperature cannot be maintained as the ice detector will already be in "stand-by" mode.

Please take note: The higher the set temperature, the higher the heating costs will be.

Design

The equipment consists of either the central control unit EM 524 89, with 1-zone, or the central control unit EM 524 90, with 2-zones, connected to either the separate ice and snow sensor ESF 524 001/011 and the combined temperature and moisture sensor TFF 524 002/012 for open space heating, or the ice and snow sensor ESD 524 003 and the temperature sensor TFD 524 004 for gutter heating. Additionally, the TFD 524 004 sensor can be connected as an air temperature sensor and to detect when there is a sudden drop in temperature.

Attention

The sensors are operated with safety extra low voltage. The appropriate regulations for safety extra low voltage and emc are to be adhered to. In order to ensure trouble-free operation, the sensor cables must be laid at a sufficient distance from the load circuit and power supply lines.

Ice and snow sensor (5-core) ESF 524 001 or ESF 524 011

The sensor is equipped with an NTC resistor to measure the sensor surface temperature, a heating coil and two metal rings as moisture sensors.

Nominal voltage:	8V-
Power consumption:	Approx. 7W
Surface temperature:	Approx. 4°C (39°F)
Connecting lead:	5 x 0.5 mm ² ; 15 m PVC (5 x 22 gauge x 50 ft.)
Ambient temperature:	-30 ... 80°C (-22 ... 176°F)
Insulating compound:	white

Sensor characteristics – sensor disconnected from EM 524 90 control unit:

a) NTC – brown-yellow wires:

°C	-15	-10	-5	0	+5	+10	+15	+20	+25	+30
°F	5	14	23	32	41	50	59	68	77	86

R (K Ohm)	84.5	61.3	47	35.0	27	20.8	16	12.7	10	8.0
-----------	------	------	----	------	----	------	----	------	----	-----


b) Heat resistor – brown-green wires: 9 Ω

c) Moisture sensors – white-grey wires: ∞ Ω with dry sensor surface


The sensor must be mounted inside the heated area and level with the ground.

Dimensions

ESF 524 001

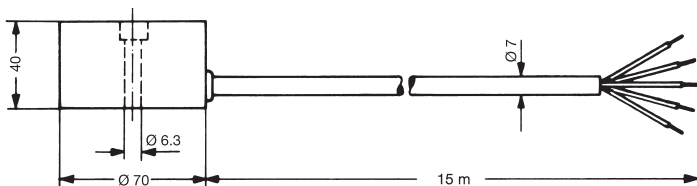

ESF 524 011
with FAG 524 111 sensor housing

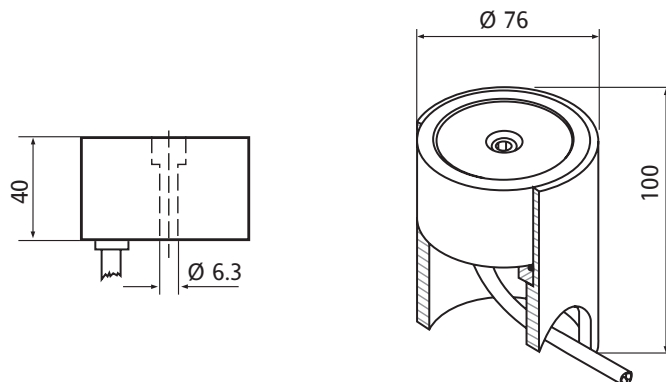

Combined temperature and moisture sensor TFF 524 002 or TFF 524 012 (4 core)

The combined sensor is equipped with an NTC resistor for ground temperature measurement and two metal rings are installed as moisture sensors. This sensor is, however, not independently heated.

Connecting lead: 4 x 0.5 mm²; 15 m PVC

Ambient temperature: -30 to 80 °C

Insulating compound: blue

Sensor characteristics – sensor disconnected from EM 524 90 control unit:


a) NTC – brown-yellow wires:

°C	-15	-10	-5	0	+5	+10	+15	+20	+25	+30
R (K Ohm)	11.7	9.1	7.2	5.7	4.6	3.7	3.0	3.4	2.0	1.6


b) moisture sensor – white-grey wires: ∞ Ω with dry sensor surface

Dimensions

TFF 524 002

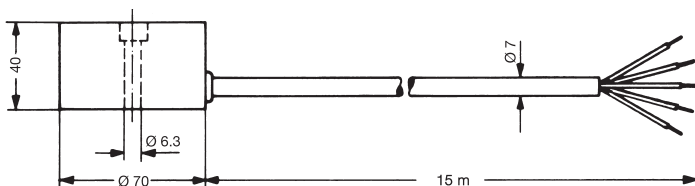


TFF 524 012
With FAG 524 111 sensor housing

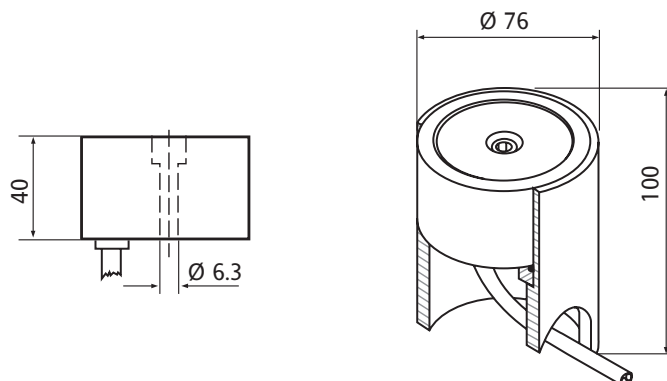

Sensor assembly

The ice and snow sensor ESF 524 001 (5 core) is assembled as follows:

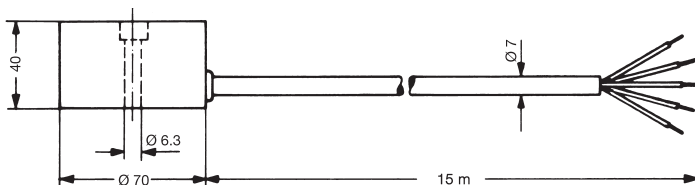

The snow and ice sensor must be mounted **outside** the heated area (see figs. 2 and 3 on page 18), or at least in a position not effected by the heating cable.

The sensor must be assembled so that it is directly exposed to the weather conditions (snow, rain, melt water (see figs. 4 and 5 on p. 19).

The position of the sensor should ideally be where moisture, snow or ice are still present, even when the area to be melted is almost fully cleared.

On inclines, always position the sensor at the lowest point, if necessary in the in the gully/ gutter.

The sensor installation must be horizontal and level, so that any remaining moisture remains on the sensor surface.

The sensor must be at ground level or lower.

The use of small stone paving is not recommended, as the water seeps into the joints. The same applies to plastered surfaces. Sealed surfaces are ideal, such as tarmac, concrete, etc.

The sensor should not be positioned in a sheltered spot. Ensure that the sensor cannot be covered, for example by snow being cleared. Any foreign bodies or materials can impair the operation of the sensor.

Positions close to the outlets of heating/air conditioning systems should be avoided, as they are not suitable for sensor. Do not position the sensor close to, or on, building components which could heat up in the sun, causing the snow to melt faster.

The sensor's steel plate is set in the ground during the construction phase and the wooden mould is placed on top. The steel plate **must** be used to fix the sensor to guarantee the impermeability of the fixing hole. If the steel plate cannot be inserted due to constructional reasons, then a washer with a nut **must** be used. This is the only way in which the impermeability (press fit) in the bolt hole can be guaranteed. Note the red information tag!


A protective metal pipe must be installed flush to the wooden block for the connection lead. Seal the pipe ends to avoid any foreign bodies (tar, concrete, etc) clogging the protective tube.

After applying the top road surface, the wooden mould is removed and the sensor is fixed on the steel plate using the M 6 x 35 screw.

Any existing gaps must be filled with, for example, silicone, tar or mortar, depending on the composition of the surface. Max. casting temperature 80 °C (176 °F).

The sensor's connection lead, default length 15 m (50 ft.), can, in accordance with VDE 0100, be extended up to a length of 50 m (164 ft.). With a cross section of 1.5mm² (20 gauge) It is recommended that a numbered cable is used for the extension. This is very helpful, for example, when trying to locate faults during a malfunction.

The combined temperature and moisture sensors TFF 524 002 (4 core) are assembled as follows:

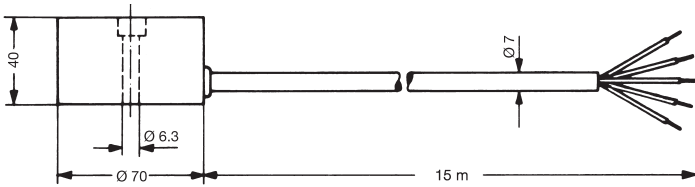

The combined sensor is installed **inside** the heated area (see figs. 2 and 3 on page 18), as it must monitor the ground temperature of the heated surface at all times (whether it is switched on or it is switched off).

Heating cables must bypass the combined sensor by a minimum of 2.5 cm (1") (see fig. 6 on page 19).

Ensure that the heating cables running parallel to one another do not touch. The combined sensor must be fitted so that it is directly exposed to the weather conditions (snow, rain, melt water, etc) (see figs. 4 and 5 on p. 19).

The combined sensor's steel plate is embedded in the ground during the construction phase and the wooden mould is placed on top. The steel plate **must** be used to fix the sensor to guarantee the impermeability of the fixing hole. If the steel plate cannot be inserted due to constructional reasons, then a washer with a nut must be used. Only in this way can the impermeability (press fit) in the bolt hole be guaranteed. Note the red information tag!

A protective metal pipe must be installed flush to the wooden block for the connection lead. Seal the pipe ends to avoid any foreign bodies (tar, concrete, etc) clogging the protective tube.

After the applying the top road surface, the wooden block is removed and the sensor is fixed onto the steel plate using a M 6 x 35 screw.

Ensure that the combined sensor is fitted so that it cannot be covered over, for example by snow being cleared outside the heated area, and that no vehicles can drive over the combined sensor (for example, when entering or leaving a garage). Any foreign bodies or materials can impair the operation of the combined sensor.

Any existing gaps must be filled, for example with silicone, tar or mortar, depending on the composition of the surface. Max. casting temperature 80 °C (176°F).

The combined sensor's connection lead, default length 15 m (50 ft.), can, in accordance with VDE 0100, be extended up to a length of 50 m (164 ft.) with a cross section of 1.5 mm² (20 gauge).

It is recommended that a numbered cable is used for the extension. This is very helpful, for example, when trying to locate faults during a malfunction!

Sensor assembly in sensor housing FAG 524 111

Determining where to fit the sensor/sensor housing is extremely important to ensure that the system works as well as it can.

The sensor must be fitted where the surface is most likely to become icy or frozen and stay this way for the longest time period.


The **ESF 524 001/011** sensor (5-core connection cable) is fitted outside the heated surface.

The **TFF 524 002/012** sensor (4 core connection cable) is fitted inside the heated surface.

Installation of the sensor in the sensor housing FAG 524 111

Only the two sensor types ESF 524 011 and TFF 524 012 are suitable for installation in the sensor housing.

With both of these sensors the connecting cable exit is on the sensor bottom. Allowing the sensor to be replaced without having to lift the hard surface.

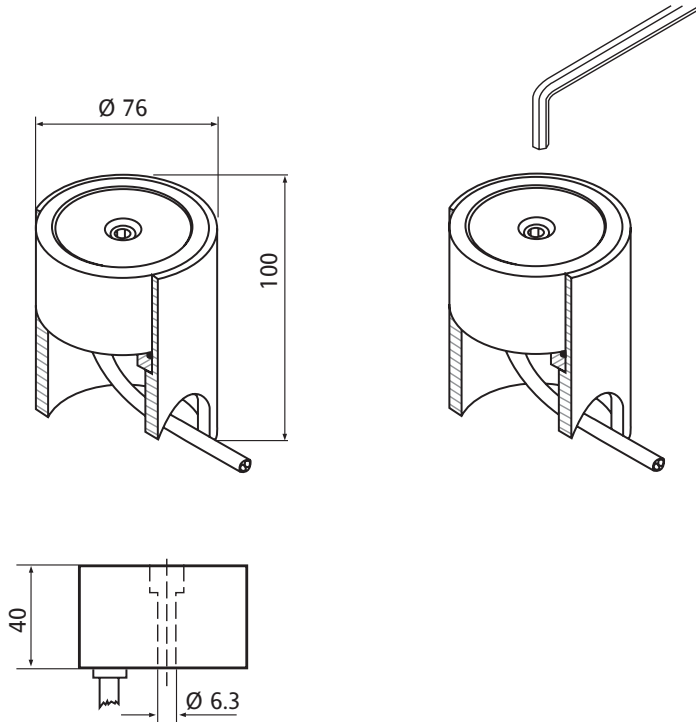

Installation of the sensor in the sensor housing FAG 524 111

A protective metal pipe running up to the sensor housing should be provided at the construction site for the connection cable.

If the sensor is to be run over an appropriate underlay (foundation or base plate) must be provided so that the sensor housing cannot be pushed into the soft ground.

Ensure that there is sufficient cable in the lower part of the sensor housing so that, when necessary, the sensor can easily be withdrawn from the housing.

Sensor housing in a concrete road surface

The sensor housing can be inserted in during the cementing process and the sensor inserted later.

Suitable measures must be taken to ensure that the concrete does not get into the housing.

The housing is to be installed so that the sensor surface is level with the ground surface. The sensor must not, under any circumstances, project from the ground surface. A level, horizontal, installation is fundamental, even with a sloping surface.

(Please refer to Assembly and operating instructions fig. 5 on page 19).

Installation examples

Fig.2

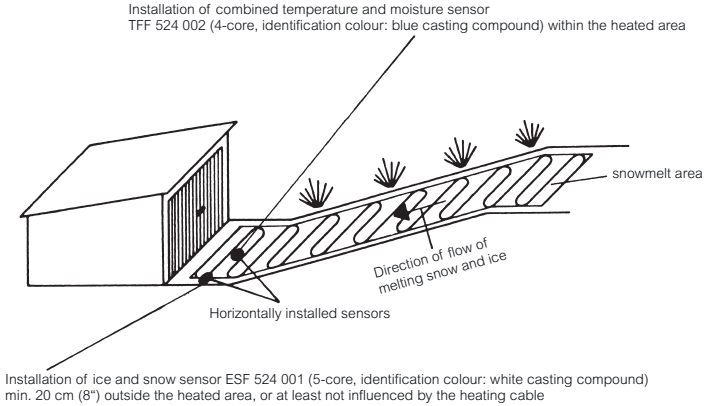


Fig.3

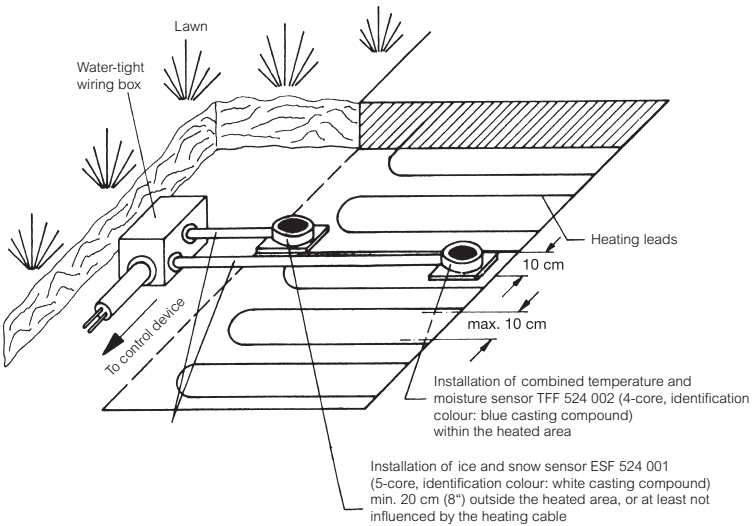


Fig.4

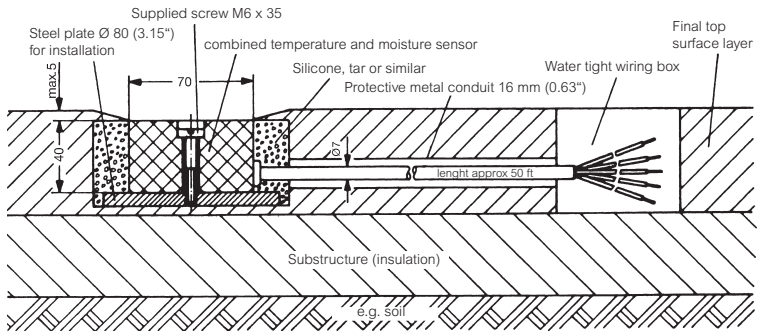


Fig.5


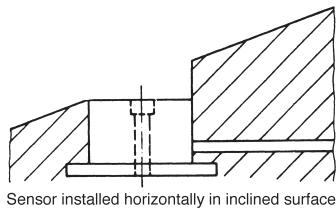


Fig.6

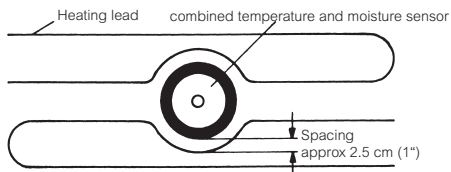

Ice and snow sensor ESD 524 003 (5-core)

The sensor is equipped with an NTC resistor for temperature measurement, a heating coil and two small metal pipes as moisture sensors.

Nominal voltage:	8 V-
Power consumption:	3 W
Surface temperature:	Approx. 4°C (39°F)
Connecting lead:	5 x 0.25 mm ² ; 4 m PVC (5 x 22 gauge x 13 ft.)
Ambient temperature:	-30 ... 80°C (-22 ... 176 °F)

Sensor characteristics – sensor disconnected from control unit:


a) NTC – brown-yellow wires:

°C	-15	-10	-5	0	+5	+10	+15	+20	+25	+30
°F	5	14	21	32	43	50	61	68	79	86
R (K-Ohm)	84.5	61.3	47	35.0	27	20.8	16	12.7	10	8.0

b) Heat resistor – brown-green wires: 20 Ω

c) Moisture sensors – white-grey wires: ∞ Ω with dry sensor surface

Dimensions

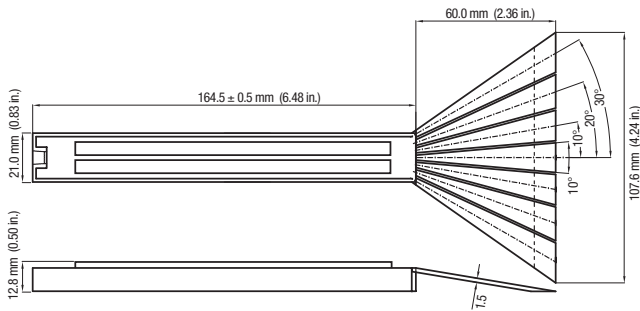

TFD 524 004 (2 core) temperature sensor

The temperature sensor is composed of a cable with a compound-filled cap on top and inbuilt NTC resistor.

Connecting lead: 2 x 0.5 mm²; 4 m PVC (2 x 20 gauge x 13 ft.)


Ambient temperature: -30 ... 80°C (-22 ... 176°F)

Sensor characteristics – sensor disconnected from control unit:

a) NTC – brown-blue wires:


°C	-15	-10	-5	0	+5	+10	+15	+20	+25	+30
°F	5	14	23	32	41	50	59	68	77	86
R(K Ohm)	11.7	9.1	7.2	5.7	4.6	3.7	3.0	3.4	2.0	1.6

Dimensions

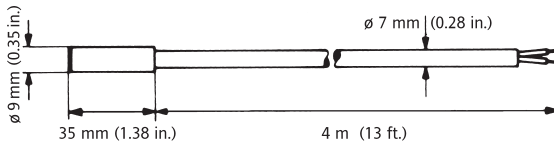

Installation

The ESD 524 003 (5 core) ice and snow sensor is assembled as follows:

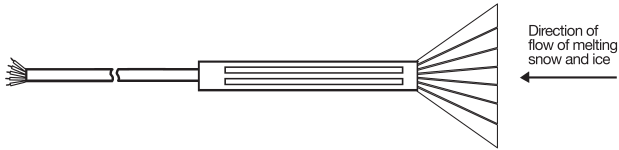

Where possible, assemble the ice and snow sensor near to the downpipe or waste pipe (lowest point) of the gutter, between the heating cables (do not let them come into contact with one another). The sensor is to be fitted so that it lies in the flow direction of the discharged water with the two metal pipes pointing upwards. The water running off is led to the sensor surface by the extruded fan. The fan can be cut to fit the existing conditions of the gutter.


The sensor's connection lead, (default length 4 m, 13 ft.), can, in accordance with VDE 0100, be extended up to a length of 50 m (164 ft.), with a cross section of 1.5mm² (20 gauge). It is recommended that a numbered cable is used when extending the connection lead. This is helpful when trying to locate faults during a malfunction.

The temperature sensor TFD 524 004 (2 core) is fitted as follows:



The temperature sensor can be fitted outside, either on the gutter or near the gutter, but whichever one you choose, care must be taken to ensure that the sensor is protected from direct sunlight. The sensor must not be fitted above windows or in areas where heat accumulation can occur (roof sills, chimney, attic windows and the like).

The sensor's connection lead, (default length 4 m, 13 ft.), can, in accordance with the VDE 0100, be extended up to a length of 50 m (164 ft.), with a cross section of 1.5mm² (20 gauge). It is recommended that a numbered cable is used when extending the connection lead. This is helpful when locating faults during a malfunction.

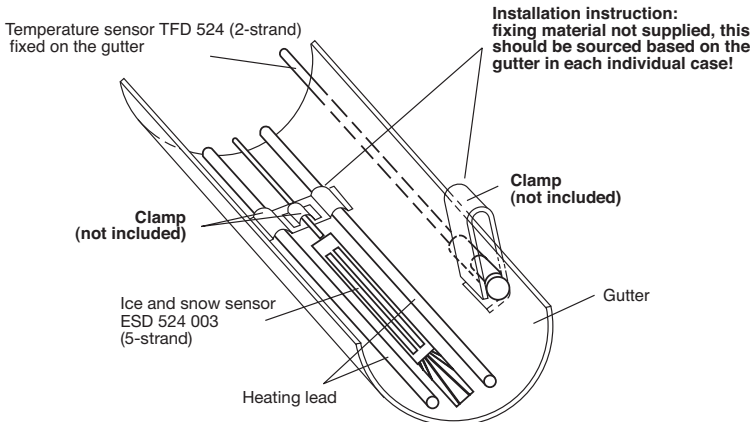

Setting desired values

Range setting

The RANGE menu item is called up with the MENU button and the lowest temperature limit is set with the Buttons – and + (EM 524 90) or the VALUE button (EM 524 89).

This temperature value specifies the lower operating temperature limit.

The upper working temperature is fixed at +6°C (43°F).

Up to this temperature limit the ice detector operates in normal mode (Heating ON, when the conditions for switching it on are satisfied). Below this temperature the ice detector will be in “Stand by” mode. Attention: The temperature range set here has priority over the base temperature.

Temperature setting

The TEMPERATURE menu item is called up with the MENU button and the desired temperature set with the Buttons – and + (EM 524 90) or the VALUE button (EM 524 89) and the value is saved by pressing ENTER.

An optimum temperature setting is +3°C (37°F).

Moisture setting:

The MOISTURE menu item is called up with the MENU button and the desired setting selected with the Buttons – and + (EM 524 90) or the VALUE button (EM 524 89). The value is saved by pressing ENTER.

An optimum moisture setting is 5. If there is a greater danger of pollution a setting of 6 or 7 should be made. If the heating switches off too early, even though there is still moisture present, you can prevent this by adjusting the moisture value to 3 or 2.

Ideally the setting should be assessed after 1-3 months of a winter season and the setting adjusted if necessary.

Base temperature setting

The BASE TEMPERATURE menu item is called up with the MENU button and the desired setting selected with the Buttons – and + (EM 524 90) or the VALUE button (EM 524 89). The value is saved by pressing ENTER. We recommend a setting of –5°C. The higher the set temperature, the higher the heating costs will be. This menu item is hidden in the roof application.

Please ensure that the ‘Base’ ground temperature set value is not lower than the lowest ‘Range’ ground temperature value set.

Operating modes

1. Default settings:

Menu	Default Value	Range	Remarks
ZONE (only available on 2-zone Controller)	A	A, B	
APPLICATION	GROUND		2
RANGE	-10°C		
TEMPERATURE	+3°C		
MOISTURE	3		
BASE TEMPERATURE	OFF		
AFTER RUN TIME	20 minutes		
OPERATION	AUTOMATIC		
SENSOR HEATER	ON		
STANDARD PROGRAM	ON		
TEMP. UNIT	User defined		2
LANGUAGE	User defined		2

2: During the initial installation the default value for the Language menu item is German, for the display menu item, °C, for the application menu item, Ground, after which these menu items no longer form part of the default settings.

In the default settings (standard program) the heating will be controlled by a combination of temperature and moisture level. The heating is switched on when the temperature falls below 3°C (37°F) and the moisture level exceeds 3. If the temperature falls below 3°C (37°F) the set after run time will be switched on. The heating will be switched off once the after run time has expired. If a moisture level of 3 is exceeded the set after run time will turn on and the heating will be switched off once this time has elapsed.

2. Normal base temperature operation

Menu	Value
BASE TEMPERATURE	-5°C (23°F)

The BASE TEMPERATURE menu item is set at -5°C (23°F), the rest of the settings are as in point 1. The operation is as described in point 1. An added factor is that with a temperature beneath -5°C the heating will be switched on regardless of the moisture level and will stay switched on until the temperature goes above -5°C (23°F). If the after run heating time is set, the heating will stay switched on till the time has elapsed.

3. Manual operation

Menu	Value
OPERATION	PERMANENT

The heating is switched on immediately and can only be switched off using this menu item. With manual operation the heating remains switched on even during alarms.

4. Operating without moisture influence

Menu	Value
TEMPERATURE	+3°C (37°F)
MOISTURE	OFF

If the MOISTURE menu item is set to OFF the ice detector will thermostatically control the heating. If the set temperature falls below the preset value the heating will be switched on and if exceeded the heating will be switched off depending on the after run time.

5. Monitoring the heated ground area when there is a sudden drop in temperature

This is an additional function and is only possible when the air temperature sensor TFD 524 004 is also connected (see connection diagram EM 524 90 using open space heating).

This air temperature sensor must be installed as well as the default sensors (Ice and snow sensor ESF 524 001/011 and combined temperature and moisture sensor TFF 524 002/012). The sensor TFD 524 004 should be fitted in a covered area approx. 2–3 m above ground level on the north side of the building, where it cannot be effected by the sun. The sensor connection is shown in the connection diagram.

If at temperatures below 7 °C (45 °F) the temperature drops suddenly by several degrees, then the heating is switched on as a precaution for 1 hour as it is highly likely that it will rain and the temperature will decrease. Depending on the set temperature and moisture level the heating will stay switched on or will switch off after 1 hour.

Attention

The air temperature sensor must not be fitted over doors, windows or next to lights or spotlights.

Maintenance

Ensure that the surfaces of the ESF 524 001/011, TFF 524 002/012 and ESD 524 003 sensors are kept clean at all times. Ideally the gutter sensor would be cleaned a minimum of once a year, the ground sensors should be cleaned whenever there is any build up on the surface of the sensor.

If there is heavy snowfall, the sensors may need to be cleared of snow, to prevent an igloo-effect.

A regular inspection of the control unit is recommended so that any alarm messages can be recognised and rectified in a timely fashion. Only then will it be possible for the system to operate flawlessly.

Storage program

		Order no.
1-zone ice detector control unit	EM 524 89	0524 89 144 100
2-zone ice detector control unit	EM 524 90	0524 90 144 100

Sensor for open space heating:

Ice and snow sensor	ESF 524 001 (cable outlet on the side) 15m connection lead	0524 99 000 001
Ice and snow sensor	ESF 524 011 (cable outlet underneath) 15 m connection lead	0524 99 000 011
Combined temperature- and moisture sensor	TFF 524 002 (cable outlet on the side) 15 m connection lead	0524 99 000 002
Combined temperature- and moisture sensor	TFF 524 012 (cable outlet underneath) 15 m connection lead	0524 99 000 012
Sensor housing (can only be used with ESF 524 011 and TFF 524 012 sensors)	FAG 524 111	0524 99 000 111


Sensor for gutter heating:

Ice and snow sensor	ESD 524 003 4 m connection lead	0524 99 000 003
Temperature sensor	TFD 524 004 4 m connection lead	0524 99 000 004

Connection diagrams for EM 524 89

Connection diagram 1:

Ice detector connection with ESF 524 001/011 and TFF 524 002/012 sensors for open space heating.

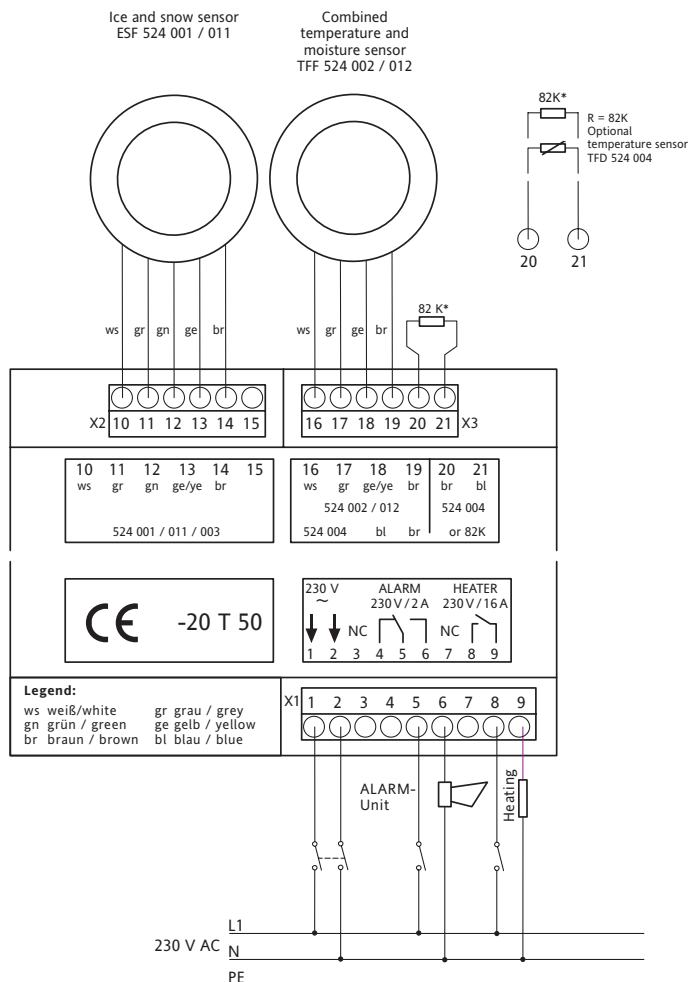


Note:

Instead of the default 82 kΩ resistor a separate TFD 524 004 temperature sensor can be installed. This sensor is used to detect a drop in temperature and the air temperature thus measured is shown on the display.

Connection diagrams for EM 524 89

Connection diagram 2: Ice detector connection with ESD 524 003 and TFD 524 004 sensors for gutter heating.

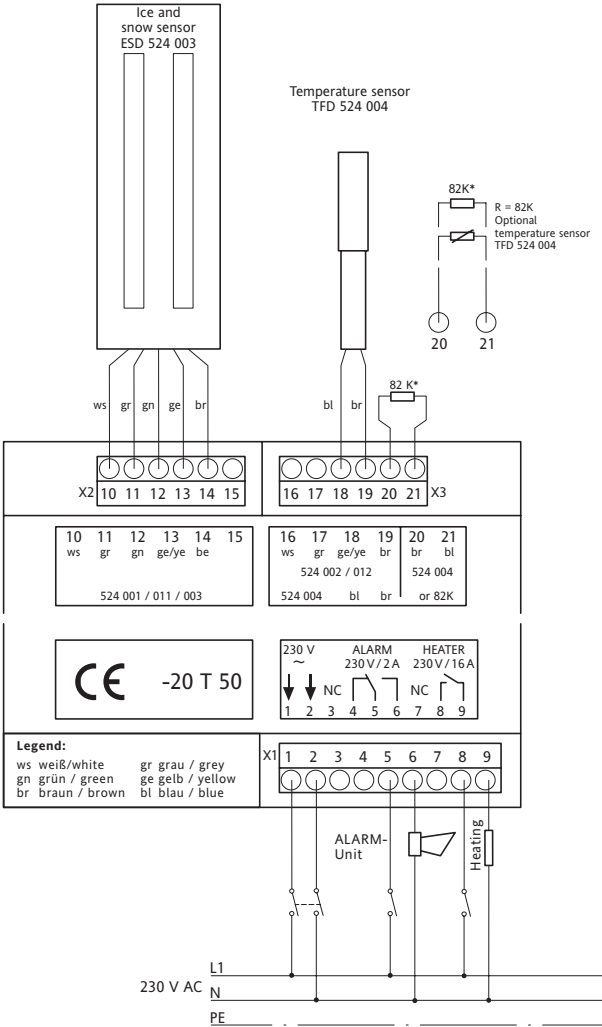

Note:

Instead of the default 82 kΩ resistor a separate TFD 524004 temperature sensor can be installed. This sensor is used to detect a drop in temperature and the air temperature thus measured is shown on the display.

Connection diagrams for EM 524 89


Connection diagram 3:

Ice detector connection with ESF 524 001 and TFD 524 004 sensors.

Open space without second moisture measuring point.

It is possible to use only sensor ESF 524 001, along with temperature sensor TFD 524 004, for ground applications, although the position of sensor ESF 524 001 is critical and should be outside the heated area, or at least not influenced by the heating cable. All other points in 'Sensor Assembly' should also be considered. Temperature sensor TFD 524 004 must be installed in the ground within the heated area, but not touching the heating cable, to detect the base ground temperature, not air temperature.


More than one moisture measurement point, using sensors ESF 524 001 and TFF 524 002, will give the optimum results, especially with larger areas.

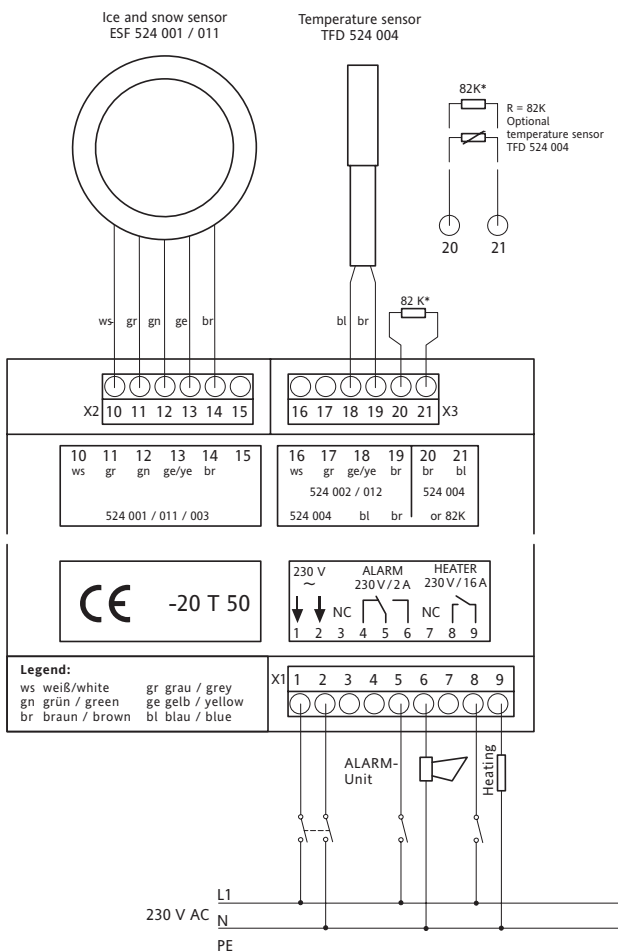

Connection diagrams for EM 524 90

Connection diagram 1:

Ice detector connection with ESF 524 001/011 and TFF 524 002/012 sensors for open space heating.

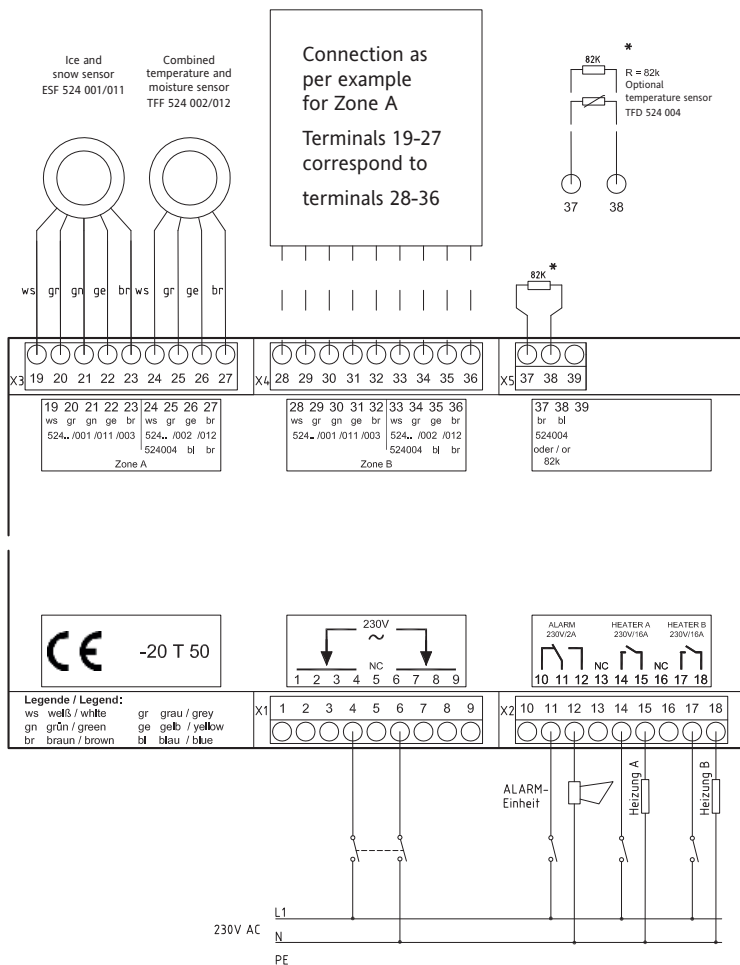


Note:

Instead of the default 82 kΩ resistor a separate TFD 524 004 temperature sensor can be installed. This sensor is used to detect a drop in temperature and the air temperature thus measured is shown on the display.

Connection diagrams for EM 524 90

Connection diagram 2: Ice detector connection with ESD 524 003 and TFD 524 004 sensors for gutter heating.

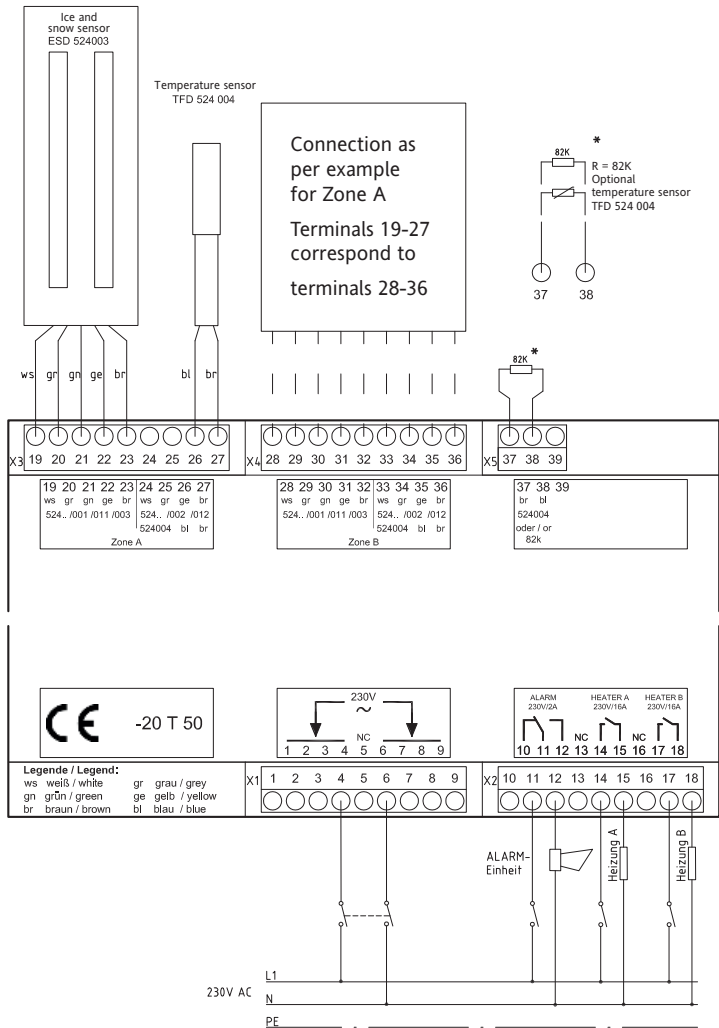

Note:

Instead of the default 82 kΩ resistor a separate TFD 524004 temperature sensor can be installed. This sensor is used to detect a drop in temperature and the air temperature thus measured is shown on the display.

Connection diagrams for EM 524 90


Connection diagram 3:

Ice detector connection with ESF 524 001 and TFD 524 004 sensors.

Open space without second moisture measuring point

It is possible to use only sensor ESF 524 001, along with temperature sensor TFD 524 004, for ground applications, although the position of sensor ESF 524 001 is critical and should be outside the heated area, or at least not influenced by the heating cable. All other points in „Sensor Assembly“ should also be considered. Temperature sensor TFD 524 004 must be installed in the ground within the heated area, but not touching the heating cable, to detect the ground temperature, not air temperature.

More than one moisture measurement point, using sensors ESF 524 001 and TFF 524 002, will give the optimum results, especially with larger areas.

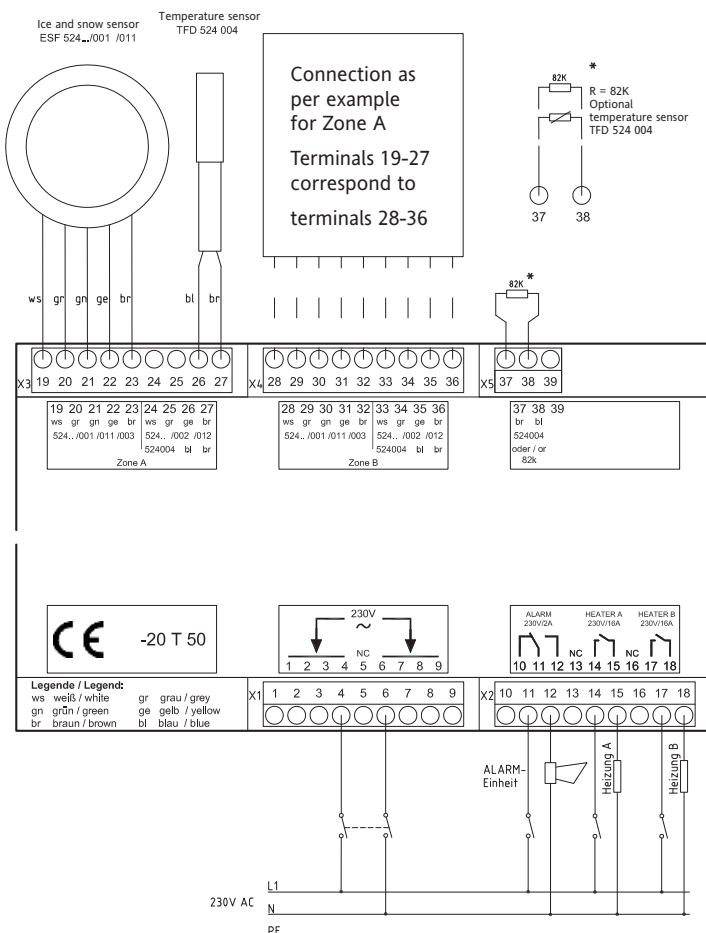

Technical data

Type	EM 52489		EM 524 90
Part no.	0524 89 144 100		0524 90 144 100
Operating voltage:	AC 230 V \pm 10 %, 50/60 Hz		
Power consumption:	\leq 15 VA		\leq 25 VA
Ambient temperature:	-20 ... + 50°C (-4 ... 122°F)		
Storage temperature:	-20 ... + 70°C (-4 ... 158°F)		

Desired value range

Range:	Lower temperature limit -5 ... -20°C (3 ... -4°F) and OFF
Temperature:	0°C ... +6°C
Base temperature:	-15 ... -1°C (5 ... 30°F) and Off
Moisture:	1 (sensitive)... 8 (insensitive) and Off
After run time:	10 min ... 24 hrs and Off
Operation:	Automatic and Permanent
Sensor Heater:	Automatic and On
Language:	German, English, French, Finnish, Swedish, Czech, Dutch, Hungarian, Turkish, Polish, Italian

Outputs

Heater On/Off:	1 relay One normally open		2 relays, Both are normally open per zone
Switching capacity:	AC 250 V, 16 A $\cos \varphi = 1$; 4 A $\cos \varphi = 0.6$		
Alarm On/Off:	Relays, 1 c/o contact		
Switching capacity:	AC 250 V, 2 A $\cos \varphi = 1$; 0.8 A $\cos \varphi = 0.6$		

Inputs

Ice and snow sensor:	Type ESF 524 001/011 for open spaces
	Type ESD 524 003 for gutters
Ground temperature sensor:	TFF 524 002/012 type for open spaces
	TFD 524 004 type for gutters
Air temperature sensor:	Type TFD 524 004

Display

LCD Display:	2-row 16-digit	
Temperatures:	-45 ... + 78 °C (-49 ... 172 °F)	
Moisture:	0 ... 9	
Heating:	ON, OFF	
Fault status:	Fault sensor	
Parameters:	Values and selection	
LED indication:	No	2 LEDs for the dialogue displaying

Below 0°C (32°F) the correct reading of the LCD display cannot be guaranteed, the operation of the equipment, however, will not be affected by this.

Controls

Input buttons:	4 piece (MENU / + / - / ENTER) for EM 524 90	
	3 piece (MENU / VALUE / ENTER) for EM 524 89	




General details

Complies with:	DIN EN 60 730 T. 1 and T. 2-9	
Protection class:	II is achieved by observing appropriate installation measures	
Protection type:	IP 20 EN 60 529	
Shockproof:	in accordance with VBG 4	
Overvoltage category	III	
Software class	A	
Rated impulse voltage	4kV	
Pollution degree	2	
Ball pressure test temperature	75 ± 2 °C	
Voltage and Current for the purposes of interference measurements	230 V; 0,1 A	
Nominal insulation voltage:	250 V	
Assembly:	Snap-on mount on DIN EN 50022-35 Standard rail	
Housing dimensions:	106 x 90 58 mm (45 cut out)	159 x 90 x 58 mm (45 cut out)
Housing material:	PC; UL94-V0	
Weight: without sensor and packaging	approx. 480 g	approx. 780 g

Dimensions

EM 524 89 (1-zone controller)

EM 524 90 (2-zone controller)

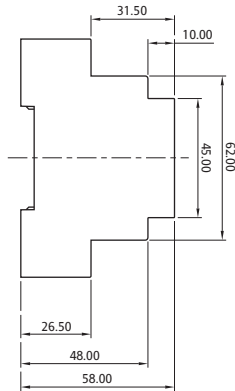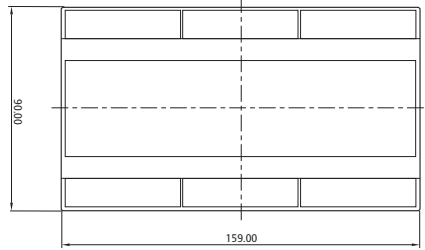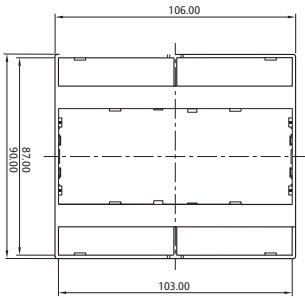

Brief operating instructions for ice detectors EM 524 89 and EM 524 90 for open space and gutter heating

Application:

The ice detector is used for the fully automatic electric heating of open spaces, garage drives, stairs, ramps, flat roofs and gutters. Unlike manually-controlled (touch dependent) or thermostatically-controlled (temperature dependent only) systems, the heating will only be switched on if there is a danger of slippery conditions such as snow, ice or sleet and will, naturally, be switched off after thawing. This ensures energy savings of up to 80% compared with thermostatically-controlled systems.

Factory Setting:

These are the factory settings and will appear when first powering up the Controller. The user should set these to the desired value at this point. Resetting the Controller to the 'STANDARD PROGRAM' will not effect these settings.

Menu	Delivery setting	Range
TEMP. UNIT	°C	°C, °F
LANGUAGE	DEUTSCH	DEUTSCH, ENGLISH, FRANCAISE, SUOMI, SVENSKA, CESKY, DUTCH, MAGYAR, TURKCE, POLSKI, ITALIANO

Operation:

For problem free operation a default program is saved. The ice detector works on the basis of this default program after installation.

These settings can be recalled at any time using the STANDARD PROGRAM menu item.

Default program:

Menu	Default value	Range	Remarks
ZONE (only available on 2-zone Controller)	A	A, B	
APPLICATION	GROUND	GROUND, ROOF, OFF	2
RANGE	-10°C (14°F)	-5 ... -20°C (23 ... -4°F), OFF	
TEMPERATURE	+3°C (37°F)	0 ... 6°C (32 ... 43°F)	
MOISTURE	3	1 – 8, OFF	
BASE TEMPERATURE	OFF	...15 ... -1°C (5 ... 30°F), OFF	1
AFTER RUN TIME	20 M	10 M ... 24 H, OFF	
OPERATION	AUTOMATIC	AUTOMATIC, PERMANENT	
SENSOR HEATER	ON	AUTOMATIC, ON	
STANDARD PROGRAM	ON	ON, OFF	
TEMP. UNIT	User defined	°C, °F	2
LANGUAGE	User defined	DEUTSCH, ENGLISH, FRANCAISE, SUOMI, SVENSKA, CESKY, DUTCH, MAGYAR, TURKCE, POLSKI, ITALIANO	2
COUNTER	xxxxxHyyM		

1: These menu items only appear in the GROUND application

2: During the initial installation the default value for the Language menu item is German, for the display menu item, °C, for the application menu item, ground, after which these menu items no longer form part of the default settings.

Use the MENU button to select all of the menu items in order. The selected menu item is shown in the top display line. The bottom display line shows the current value for this menu item and "ACTIVE".

For example: _____ TEMPERATURE
3°C ACTIVE

The desired value can be changed with the buttons – and + (EM 524 90) or the VALUE button (EM 524 89). The current value is marked with the word ACTIVE.

If another value is selected only this will show in the bottom line.

To select this value as the setting, press ENTER. The new value will be applied to the control program and displayed with the word ACTIVE.

If you do not press ENTER or, if after you have selected the new desired value with the Buttons – and + (EM 524 90) or the VALUE button (EM 524 89), another menu item is selected with the MENU button, the new value will not be applied. If no button is pushed for 20 seconds the display changes to "Measured value" mode. The mode changes between display of the measured temperatures and the moisture and heating at 3 second intervals. If the supplied resistor is connected instead of the air temperature sensor, the value for the air temperature is not shown.

For example: _____ GROUND –11°C
 AIR –11°C

 and

 MOISTURE 7
 HEATING ON

Should there be an alarm, the display starts flashing at one second intervals. The alarm relay closing contact (terminals 11 and 12) closes. The word "ALARM" appears on the top line. At the same time, the cause of the alarm is displayed on the bottom line. The measured values continue to be displayed:

For example: _____ ALARM
 TEMP SHORT CIRCUIT

Here the display also changes to menu mode when the button is pushed, but in this instance the display flashes, to continue drawing attention to the alarm. During an alarm the menu items can be selected, for example, leaving the heating system switched on in manual mode. If no button is pushed for 20 seconds the alarm will be displayed again.



This product should not be disposed of with household waste.
Please recycle the products where facilities for electronic waste exist.
Check with your local authorities for recycling advice.

EBERLE

EBERLE Controls GmbH

Postfach 130153 · D-90113 Nürnberg
Klingenhofstrasse 71 · D-90411 Nürnberg/Germany
T +49 (0) 9 11/56 93-0 · F +49 (0) 9 11/56 93-536
E-Mail: info@eberle.de
www.eberle.de

In accordance with our continuous improvement procedures, we reserve the right to change design features and specifications without prior notification. The data contained in this document is for guidance only. EBERLE Controls GmbH accepts no liability for any consequential losses, injury or damage resulting from the use of this document or the information contained within.